

Eclipse Locktite Manual Reset Gas Shut-Off Valves

Series 200 LT

- UL listed, FM & CSA approved.
- Snap-acting solenoid for fast closing.
- Two visual indicators of valve position.
- Raintight construction.
- Soft seat disc for positive shut-off.
- Two built-in auxiliary switches.
- Ball bearing tip mechanism reduces wear.
- Lever with extension chains available for remote mounting.
- 100% factory tested before shipment.

Eclipse 200 LT valves are manually opening valves that automatically shut off gas supply to a combustion system when any interlocking limit switch opens. The valve handle cannot be reset until the condition causing the open switch is corrected and all limit switches are closed. Typical limit switches include air pressure, gas pressure, temperature limit, and flame monitoring contacts. In the event of a power failure, the valve immediately closes.

Series 200 LT valves include two visual indicators of "open" or "closed" position: a red "flag" visible in the plastic dome on top of the valve; and the reset handle position as indicated by cast markings on the operator case. These valves also include two SPDT micro-switches that can be used for auxiliary circuits. Two contacts are made when the valve opens, and two are made when the valve is closed.

U.S. Patent No. 3,259,357
Canadian Patent No. 764,833



Listed 326B



APPROVED




CGA 3.9
CSA 6.5/ANSI Z21.21




200 LT Specification

Temperature Limits	+125° to -20° F (+52° to -29° C) fluid and ambient . Below 32° F (0° C) the gas must be free of water vapor which could condense and freeze within the valve.	
Maximum Inlet & Differential Pressure	1" thru 2" 2-1/2" thru 4"	30psig 20psig
Gases	UL listed for air, natural gas, LP gas and hydrogen. FM approved for natural, LP and manufactured gases. CSA approved for natural, LP, mixed and manufactured gases. Contact Eclipse for other gases. For corrosive or wet gases such as coke oven or digester gas, corrosion-resistant valve trim must be installed at Eclipse.	
Electrical	Volts/Cycles Holding Current Auxiliary Switches (2)	115/120 volt 50/60 hz standard. 220/50 or 240/60 available. 35 VA at 120 volt 8 amp, 1/3 hp, 120 or 240 volts A.C.
Approvals	UL Listed, FM & CSA approved	

Design Features

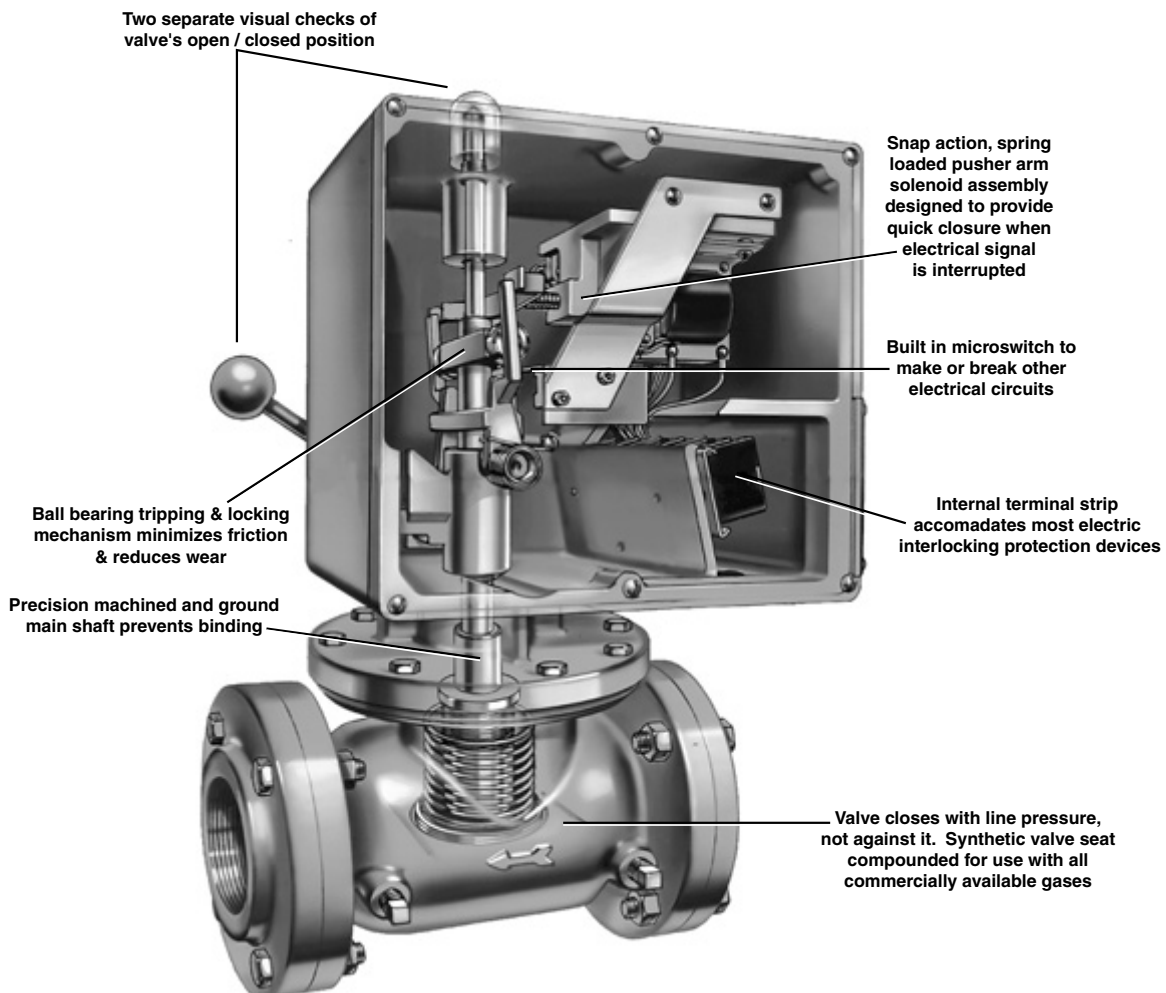

Capacities*

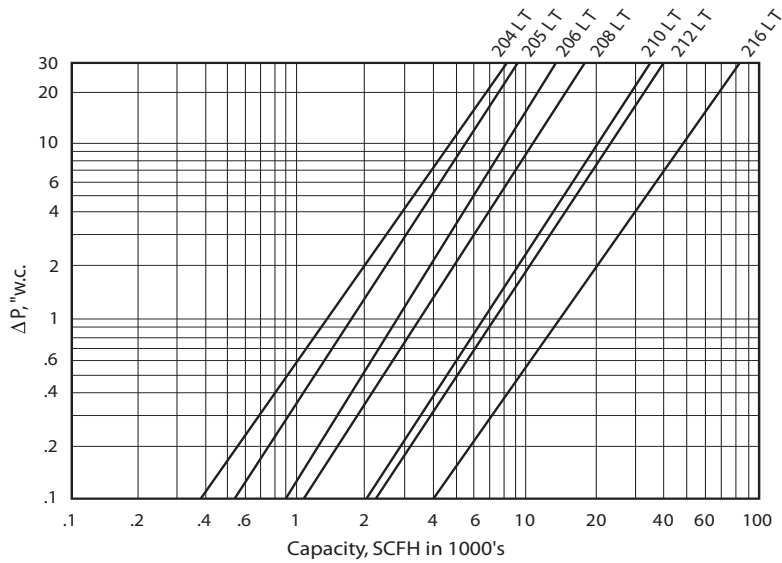

*For natural gas (.6 s.g.) with an inlet pressure no higher than 1.1 psig. For other gases, multiply capacity by:

Butane (2.0 s.g.)	.548
Propane (1.5 s.g.)	.628
Air (1.0 s.g.)	.775

Allowable Mounting Positions

Factory Supplied Operator Position	#1 (Standard)	#2	#3	#4
Part Number Designation	Assembly No. (None)	Assembly No. -P2	Assembly No. -P3	Assembly No. -P4
Valve Mounted With Operator Straight Up or Down				
Valve Mounted With Wiring Box Cover Facing Up				

200 LT valves can be supplied with the operator rotated in any of four positions with respect to the valve body, #1, #2, #3, and #4. Position #1 is supplied standard. Add -P2, -P3, or -P4 to the end of the assembly number to specify other mounting positions. The sketches above show the allowable mounting orientations for each of the four factory-supplied operator positions. The operator must not be mounted in a position other than those shown.



Note: Field changing the operator position can result in damage. Please contact your Eclipse representative if rotation of the operator after shipment is required.

